
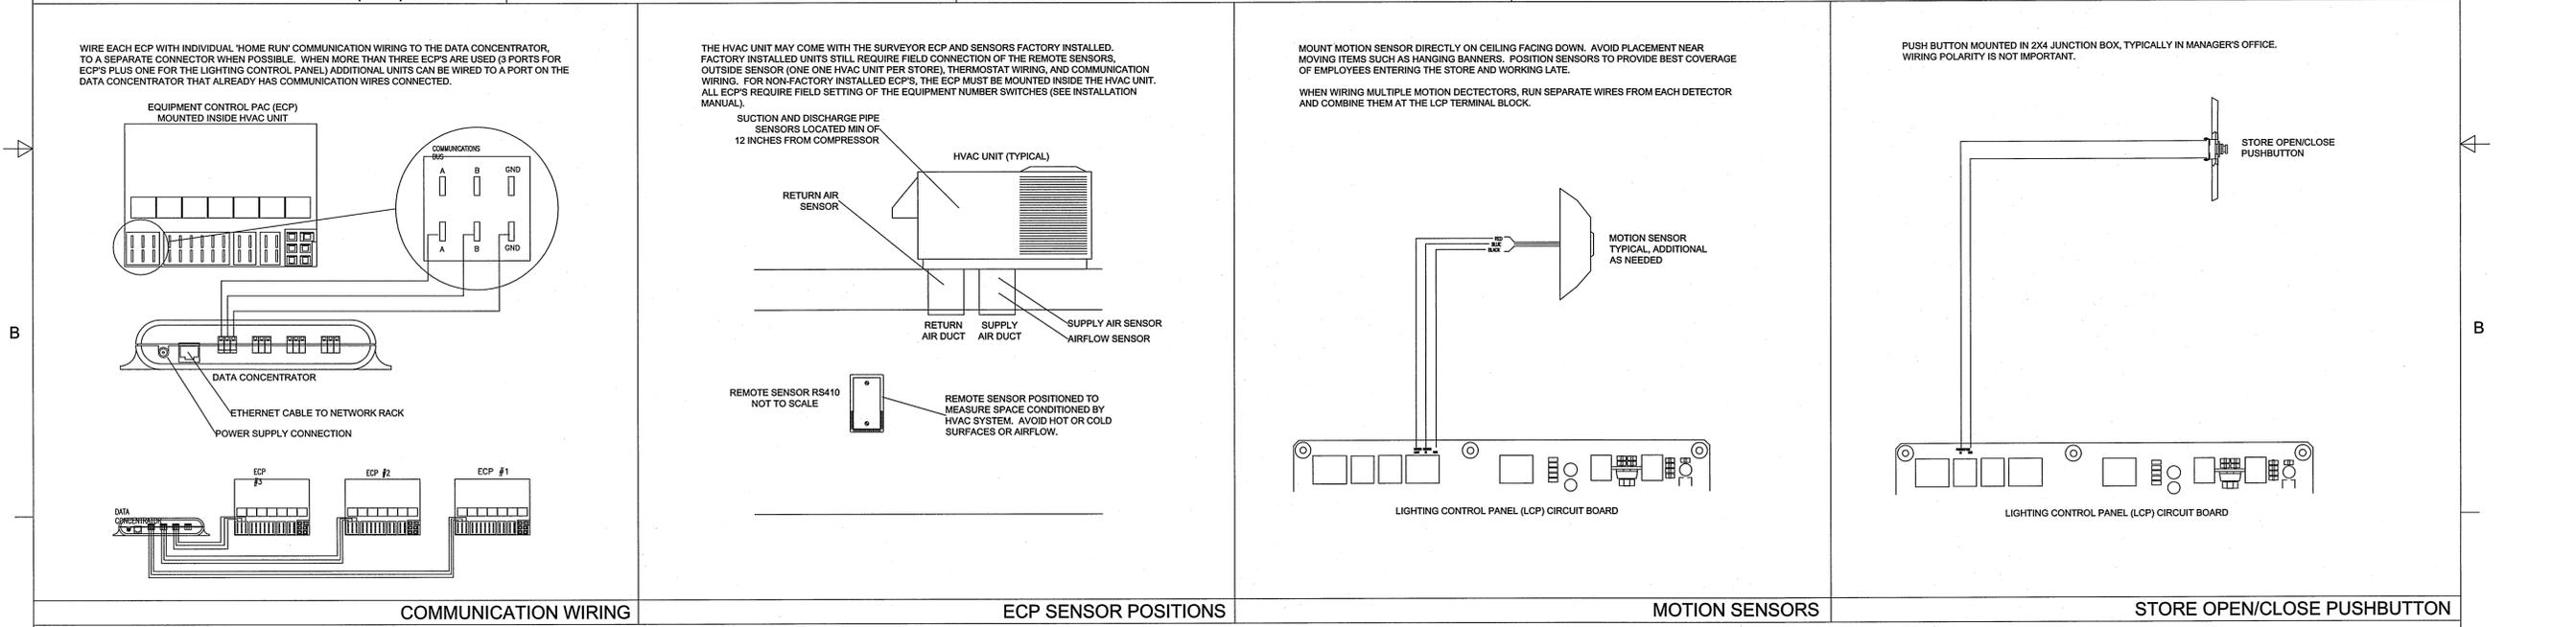


RECEIVED
LCP 2 6 2013
1736 EAST SUNSHINE ST. SUITE 417
SPRINGFIELD, MO

REGISTERED PROFESSIONAL
ELECTRICAL ENGINEER
9126/114
OREGON
JULY 14, 2009
NORMAN E. GOTTLIEB
Expires: 6/30/15

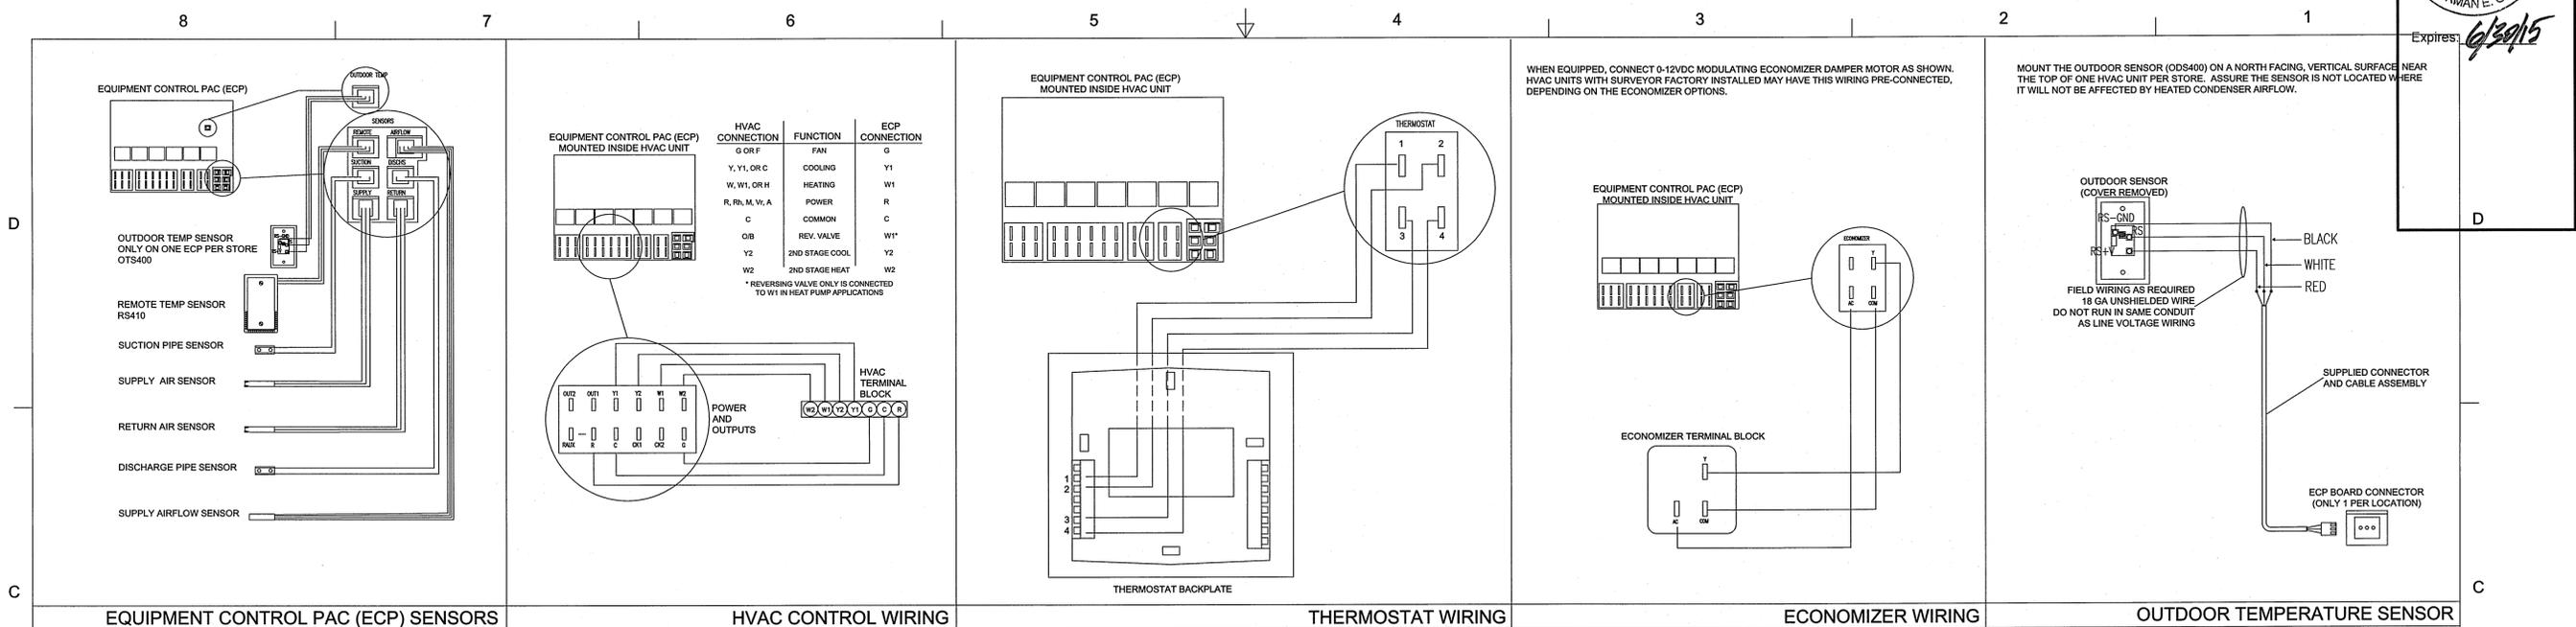

GENERAL NOTES:

- DRAWING FOR GENERAL INFORMATION ONLY.
- LOCAL BUILDING CODES AND BUILDING PLANS, AND STORE TAKE PRECEDENCE OVER THIS DOCUMENT.
- REFER TO THE SURVEYOR MANUAL, AND INSTALLATION INSTRUCTIONS FOR EACH COMPONENT FOR ADDITIONAL CRITICAL INFORMATION.
- SOME HVAC UNITS ARE AVAILABLE WITH THE SURVEYOR ECP AND SENSORS PRE-INSTALLED. THE REMOTE SENSOR AND ONE OUTSIDE SENSOR PER STORE WILL NEED TO BE CONNECTED IN THE FIELD TO THE ECP.
- ALL ECP'S REQUIRE SETTING OF THE EQUIPMENT NUMBER DIP SWITCHES, AND HEAT PUMP JUMPERS AS APPROPRIATE. REFER TO THE EQUIPMENT CONTROL PAC INSTALLATION INSTRUCTIONS FOR FURTHER INFORMATION.
- ALL WIRING 18 GA UNSHIELDED, OR TWISTED PAIR.
- WIRING MAY BE RUN IN CONDUIT OR WIRE TIED IN BUNDLES.
- DO NOT RUN COMMUNICATION AND SENSOR WIRES IN THE SAME CONDUIT OR BUNDLE WITH CONTROL AND LINE VOLTAGE WIRING.
- CAUTION! INSTALLATION REQUIRES REMOVAL OF SAFETY COVERS AND EXPOSE THE INSTALLER TO ELECTRICAL HAZARDS. USE OF A LICENSED ELECTRICIAN IS REQUIRED. FOLLOW ALL APPROPRIATE SAFETY PRECAUTIONS. ADDITIONAL SAFETY INFORMATION IS IN THE SURVEYOR INSTALLATION MANUALS.

VENSTAR INC.

SURVEYOR

O'REILLY INSTALLATION DETAILS

SIZE	DATE	DWG NO	REV
D	9-13-13	S13-002	-
SCALE	NONE	DRAWN	C. GODWIN
		SHEET	1 OF 1

Thomas A. Lundberg
ARCHITECT
1736 East Sunshine, Suite 417
Springfield, Missouri 65804
e-mail: architect@esterlystaylor.com

1736 EAST SUNSHINE ST. SUITE 417
SPRINGFIELD, MO 65804
417-862-2200
417-862-2265

O'Reilly AUTO PARTS
233 SOUTH PATTERSON
SPRINGFIELD, MISSOURI 65802
417-862-2674 PHONE

VENSTAR INC.
SURVEYOR
O'REILLY INSTALLATION DETAILS

COMM # 3484

DATE: 09-27-13
REVISION DATE: 04-23-14

SGE
SMITH-GOTH ENGINEERS, INC.
3855 S. JEFFERSON AVE. P: 417-882-2200
SPRINGFIELD, MO 65807 F: 417-882-1188
WWW.SMITHGOTH.COM

04-23-14
VS2 of 3